

# Fluke 1623-2 and 1625-2

## GEO Earth Ground Testers

## Technical Data

The new Fluke 1623-2 and 1625-2 GEO Earth Ground Testers offer data storage and download capabilities via USB port. World class accessories will simplify and speed up testing time.

### Product features:

- 3- and 4-pole Fall of Potential, earth resistance loop testing
- 4-pole Soil Resistivity testing
- Selective earth ground rod testing using 1 clamp
- Stakeless earth ground rod testing using 2 clamps
- IP56 rated for outdoor use
- Professional carrying case
- USB data storage and transfer

### In addition, the Fluke 1625-2 offers these advanced features:

- Automatic Frequency Control (AFC)—identifies existing interference and chooses a measurement frequency to minimize its effect, providing more accurate earth ground value
- R\* measurement—calculates earth ground impedance at 55 Hz to more accurately reflect the earth ground resistance that a fault-to-earth ground would see
- Adjustable limits—for quicker testing

### Stakeless testing

The Fluke 1623-2 and 1625-2 earth ground testers are able to measure earth ground loop resistances using only clamps. With this test method, two clamps are placed around the earth ground

rod and each are connected to the tester. No earth ground stakes are used at all. A known, fixed voltage is induced by one clamp and the current is measured using the second clamp. Then the tester automatically determines the resistance of the earth ground rod.

This test method only works if a bonded earth ground system exists for the building or structure under test, but most are. If there is only one path to ground, like at many residential applications, the Stakeless method will not provide an acceptable value and the Fall of Potential test method must be used.

With Stakeless testing, the earth ground rod does not need to be disconnected—leaving the bonded earth ground system intact during test. Gone are the days of spending time placing and connecting stakes for each earth ground rod on your system—a major time saver. You can also perform earth ground tests in places you've not considered before: inside buildings, power pylons, or anywhere you don't have access to soil.



### The most complete testers

The Fluke 1623-2 and 1625-2 are distinctive earth ground testers that can perform all four types of earth ground measurement:

- 3- and 4-Pole Fall of Potential (using stakes)
- 4-Pole Soil Resistivity testing (using stakes)
- Selective testing (using 1 clamp and stakes)
- Stakeless testing (using 2 clamps only)


The testers are also easy to use. For each test, the testers inform you which stakes or clamps need to be connected and the large rotary switch can be used even with a gloved hand.

The complete model kit comes with the 1623-2 or 1625-2 tester, test leads, 4 earth ground stakes, 3 cable reels with wire, 2 clamps, batteries, and manual—all inside a professional Fluke carrying case.

## 1625-2 Specifications

### General

Memory	Internal memory storage up to 1500 records accessible via USB port
Measuring function	Interference voltage and frequency, earthing resistance 3- and 4-pole with/without clip-on current transformer, resistance 2-pole with ac, 2- and 4-pole with dc
Display	4 digit (2999 Digit) - 7 segment liquid crystal display, with improved visibility
Operation	Central rotary switch and function keys

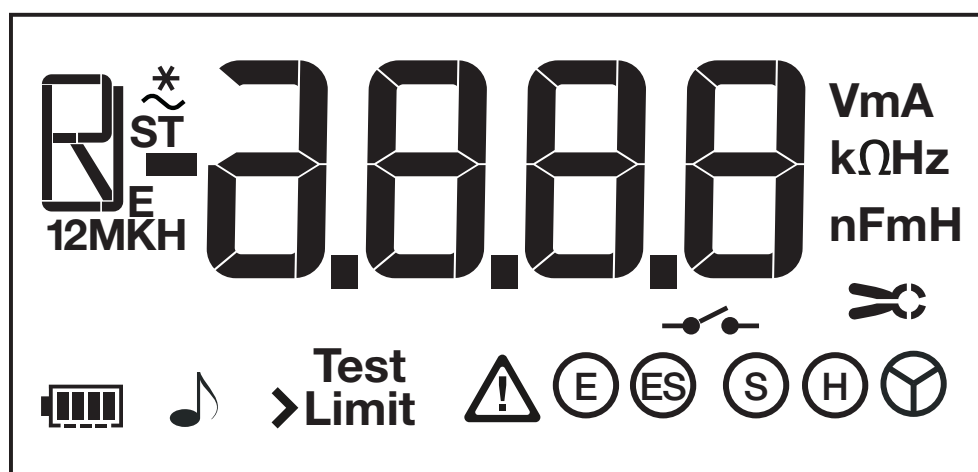

### Temperature ranges

Operating temperature range	-10 °C to 50 °C (14° F to 122° F)
Storage temperature range	-30 °C to 60 °C (-22° F to 140° F)

Temperature coefficient	± 0.1 % of range/± 0.1 % of reading/°C <18 °C >28 °C
-------------------------	--

Type of protection	IP56 for case, IP40 for battery door according to EN60529
Max voltage	<p>⚠ socket ➤ to socket (E) (ES) (S) (H)</p> <p><math>U_{ms} = 0\text{ V}</math></p> <p>Sockets " (E) (ES) (S) (H) " to each other in any combination, max. <math>U_{ms} = 250\text{ V}</math> (pertains to misuse)</p>
Safety:	Protection by double and/or reinforced insulation. Max. 50 V to earth per IEC61010-1. CAT none, Pollution degree 2
EMC (Emission Immunity)	IEC61326-1: Portable
Quality standard	Developed, designed and manufactured to comply with DIN ISO 9001
External field influence	Complies with DIN 43780 (8/76)
Auxiliary power	6 x 1.5 V alkaline (IEC LR6 or type AA )
Battery life span	<p>With IEC LR6/type AA: typ. 3,000 measurements (<math>R_E + R_H \leq 1\text{ k}\Omega</math>)</p> <p>With IEC LR6/type AA : typ. 6,000 measurements (<math>R_E + R_H &gt; 10\text{ k}\Omega</math>)</p>
Dimensions (WxHxD)	250 mm x 133 mm x 187 mm (9.75 in x 5.25 in x 7.35 in)
Weight	<p>≤ 1.1 kg (2.43 lb) without accessories</p> <p>7.6 kg (16.8 lb) including accessories and batteries in carrying case</p>
Case material	Polyester

## Measurement of interference voltage dc + ac ( $U_{st}$ )

Measuring Limits of error: method		Fullwave rectification		
Measuring Range	Display Range	Resolution	Frequency Range	Limits of Error
1 V to 50 V	0.0 V to 50 V	0.1 V	dc/ac 45 Hz to 400 Hz sine	$\pm (5 \% \text{ of rdg} + 5 \text{ digit})$
Measuring sequence	approx. 4 measurements/s			
Internal resistance	approx. 1.5 M $\Omega$			
Max. overload	$U_{rms} = 250 \text{ V}$			

## Measurement of interference frequency (F)

Measuring method	Measurement of oscillation period of the interference voltage			
Measuring Range	Display Range	Resolution	Range	Accuracy
6.0 Hz to 400 Hz	16.0 Hz to 299.9 Hz to 999 Hz	0.1 Hz to 1 Hz	1 V to 50 V	$\pm (1 \% \text{ of rdg} + 2 \text{ digit})$

## Earthing resistance ( $R_E$ )

Measuring method	Current and voltage measurement with probe as IEC61557-5
Open circuit voltage	20/48 V, ac
Short circuit current	250 mA ac
Measuring frequency	94, 105, 111, 128 Hz selected manually or automatic. (AFC) 55 Hz in function R*
Noise rejection	120 dB ( $16^{2/3}$ , 50, 60, 400 Hz)
Max. overload	$U_{rms} = 250 \text{ V}$

## Electrical measurement specifications

Intrinsic error or influence quantity	Reference conditions or specified operating range	Designation code	Requirements or test in accordance with the relevant parts of IEC 1557	Type of test
Intrinsic error	Reference conditions	A	Part 5, 6.1	R
Position	Reference position $\pm 90^\circ$	E1	Part 1, 4.2	R
Supply voltage	At the limits stated by the manufacturer	E2	Part 1, 4.2, 4.3	R
Temperature	0 °C and 35 °C	E3	Part 1, 4.2	T
Series interference voltage	See 4.2 and 4.3	E4	Part 5, 4.2, 4.3	T
Resistance of the probes and auxiliary earth electrodes	0 to 100 x $R_A$ but $\leq 50 \text{ k}\Omega$	E5	Part 5, 4.3	T
System frequency	99 % to 101 % of the nominal frequency	E7	Part 5, 4.3	T
System voltage	85 % to 110 % of the nominal voltage	E8	Part 5, 4.3	T
Operating error	$B = \pm  A  + 1,15 \sqrt{E_1^2 E_2^2 E_3^2 E_4^2 E_5^2 E_6^2 E_7^2 E_8^2}$		Part 5, 4.3	R
A = intrinsic error En = variations R = routine test T = type test		$B[\%] = \pm \frac{B}{\text{fiducial value}} \times 100 \%$		

Measuring Range	Display Range	Resolution	Accuracy	Operating Error
0.020 Ω to 300 kΩ	0.001 Ω to 2.999 Ω	0.001 Ω	± ( 2 % of rdg + 2 digit )	± ( 5 % of rdg + 5 digit )
	3.00 Ω to 29.99 Ω	0.01 Ω		
	30.0 Ω to 299.9 Ω	0.1 Ω		
	0.300 kΩ to 2.999 kΩ	1 Ω		
	3.00 kΩ to 29.99 kΩ	10 Ω		
	30.0 kΩ to 299.9 kΩ	100 Ω		

Measuring time	typ. 8 sec. with a fixed frequency 30 sec. max. with AFC and complete cycle of all measuring frequencies
Additional error because of probe-and auxiliary earth electrode resistance	$\frac{R_H (R_S + 2000 \Omega)}{R_E} \times 1.25 \times 10^{-6} \% + 5 \text{ digits}$
Measuring error of RH and RS	typ. 10 % of $R_E + R_S + R_H$
Max. probe resistance	≤ 1 MΩ
Max. auxiliary earth electrode resistance	≤ 1 MΩ

Automatic check if error is kept within the limits required by IEC61557-5.


If after a measurement of probe-, auxiliary earth electrode- and earthing resistance, a measurement error of higher than 30 % is assumed because of the influencing conditions (see diagram), the display shows a warning symbol  $\Delta$  and a notice that  $R_S$  or  $R_H$  are too high.

### Automatic switchover of measuring resolution in dependence to auxiliary earth electrode resistance $R_H$

RH with $U_{\text{meas}} = 48 \text{ V}$	RH with $U_{\text{meas}} = 20 \text{ V}$	Resolution
< 300 Ω	< 250 Ω	1 mΩ
< 6 kΩ	< 2.5 kΩ	10 mΩ
< 60 kΩ	< 25 kΩ	100 mΩ
< 600 kΩ	< 250 kΩ	1 Ω

### Selective measurement of the earthing resistance ( $R_E \gg C$ )

Measuring method	Current and voltage measurement with probe as per EN61557-5 and current measurement in the individual branch with additional current transformer (patent applied for).
Open circuit voltage	20/48 V ac
Short circuit current	250 mA ac
Measuring frequency	94, 105, 111, 128 Hz selected manually or automatically (AFC), 55 Hz ( $R^*$ )
Noise rejection	120 dB ( $16^{2/3}$ , 50, 60, 400 Hz)
Max. overload	Max. $U_{\text{rms}} = 250 \text{ V}$ (measurement will not be started)

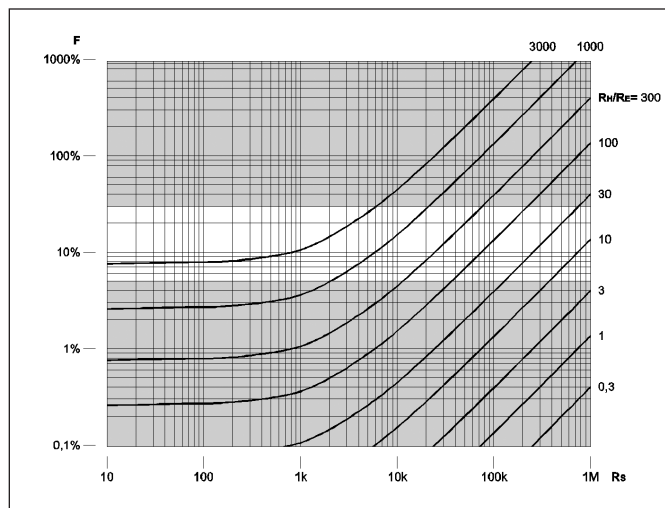

Measuring Range	Display range	Resolution	Intrinsic error*	Operating error*
0.020 Ω to 30 kΩ	0.001 to 2.999 Ω	0.001 Ω	± (7 % of rdg + 2 digit)	± (10 % of rdg + 5 digit)
	3.00 to 29.99 Ω	0.01 Ω		
	30.0 to 299.9 Ω	0.1 Ω		
	0.300 to 2.999 kΩ	1 Ω		
	3.00 to 29.99 kΩ	10 Ω		

\* With recommended current clamps/transformers.

<b>Additional error because of probe- and auxiliary earth typ. electrode resistance</b>	$\frac{R_H (R_S + 2000 \Omega)}{R_{ETOTAL}} \times 1.25 \times 10^{-6} \% + 5 \text{ digits}$	
<b>Measuring error of <math>R_H</math> and <math>R_S</math></b>	Typ. of 10 % of $R_{ETOTAL} + R_S + R_H$	
<b>Measuring time</b>	Typ. 8 sec. with a fixed frequency 30 sec. max. with AFC and complete cycle of all measuring frequencies	
<b>Minimal current in single branch to be measured</b>	0.5 mA	With transformer (1000:1)
	0.1 mA	With transformer (200:1)
<b>Max. interference current through transformer</b>	3 A	With a transformer (1000:1)

## Resistance measurement (R~)

<b>Measuring method</b>	Current and voltage measurement
<b>Measuring voltage</b>	20 V ac, square pulse
<b>Short circuit current</b>	> 250 mA ac
<b>Measuring frequency</b>	94, 105, 111, 128 Hz selected manually or automatically (AFC)

Measuring range	Display range	Resolution	Accuracy	Operating errors
0.020 $\Omega$ to 300 k $\Omega$	0.001 $\Omega$ to 2.999 $\Omega$	0.001 $\Omega$	$\pm (2 \% \text{ of rdg} + 2 \text{ digit})$	$\pm (5 \% \text{ of rdg} + 5 \text{ digit})$
	3.0 $\Omega$ to 29.99 $\Omega$	0.01 $\Omega$		
	30 $\Omega$ to 299.9 $\Omega$	0.1 $\Omega$		
	300 $\Omega$ to 2999 $\Omega$	1 $\Omega$		
	3.0 k $\Omega$ to 29.99 k $\Omega$	10 $\Omega$		
	30.0 k $\Omega$ to 299.9 k $\Omega$	100 $\Omega$		

<b>Measuring time</b>	typ. 6 sec.
<b>Max. interference voltage</b>	24 V, with higher voltages measurement will not be started
<b>Max overload</b>	$U_{rms}$ max. = 250 V


## Resistance measurement (R---)

<b>Measuring method</b>	current- voltage measurement as per IEC61557-4 possible
<b>Open circuit voltage</b>	20 V dc
<b>Short circuit current</b>	200 mA dc
<b>Formation of measured value</b>	with 4-pole measurement wires on H, S, ES can be extended without additional error. Resistances > 1 $\Omega$ in wire E can cause additional error of 5m $\Omega/\Omega$ .

Measuring range	Display range	Resolution	Accuracy	Operating error
0.020 $\Omega$ to 3 k $\Omega$	0.001 $\Omega$ to 2.999 $\Omega$	0.001 $\Omega$	$\pm (2 \% \text{ of rdg} + 2 \text{ digit})$	$\pm (5 \% \text{ of rdg} + 5 \text{ digit})$
	3.0 $\Omega$ to 29.99 $\Omega$	0.01 $\Omega$		
	30.0 $\Omega$ to 299.9 $\Omega$	0.1 $\Omega$		
	300 $\Omega$ to 2999 $\Omega$	1 $\Omega$		

<b>Measuring sequence</b>	Approx. 2 measurements/s
<b>Measuring time</b>	Typ. 4 sec. incl. reversal of polarity (2-pole or 4-pole)
<b>Max. interference voltage</b>	$\leq 3$ V ac or dc, with higher voltages measurement will not be started
<b>Max inductivity</b>	2 Henry
<b>Max. overload</b>	$U_{rms} = 250$ V

## Compensation of lead resistance ( $R_k$ )

Compensation of lead resistance ( $R_k$ ) can be switched on in functions $R_E$ 3-pole, $R_E$ 4-pole  , $R_{\sim}$ , and $R_{\equiv}$ 2-pole	
<b>Formation of measured value</b>	$R_{\text{display}} = R_{\text{measured}} - R_{\text{compensated}}^*$

\* Value of setpoint entry  $R_k = 0.000 \Omega$ , variable from  $0.000$  to  $29.99 \Omega$  by means of measuring adjustment.

## Stakeless ground loop measurement ()

Switch position	Resolution	Measuring range	Accuracy	Operating error
$R_A$ 4-pole	$0.001 \Omega$ to $0.1 \Omega$	$0.02 \Omega$ to $199.9 \Omega$	$\pm (7 \% \text{ rdg} + 3 \text{ d})$	$\pm (10 \% \text{ rdg} + 5 \text{ d})$

### Measuring principle: Stakeless measurement of resistance in closed loops using two current transformers

<b>Measuring voltage</b>	$V_m = 48 \text{ V ac (primary)}$
<b>Measuring frequency</b>	$128 \text{ Hz}$
<b>Noise current (<math>I_{\text{EXT}}</math>)</b>	Max. $I_{\text{EXT}} = 10 \text{ A (ac)}$ ( $R_A < 20 \Omega$ )
	Max. $I_{\text{EXT}} = 2 \text{ A (ac)}$ ( $R_A > 20 \Omega$ )

Automatic range selection

The information regarding stakeless ground loop measurements is only valid when used in conjunction with the recommended current clamps at the minimum distance specified.

## Selection guide by user

	Field Service Technician	Industrial Maintenance Technician	Power Utilities and Telecom
Fluke 1623-2	•	•	
Fluke 1625-2		•	•

## Standard earth ground test methods

	Fall of Potential		Selective	Stakeless
	3-pole	4-pole/soil	1 clamp	2 clamps
Fluke 1623-2	•	•	•	•
Fluke 1625-2	•	•	•	•

## Ordering information

Fluke-1623-2 Kit	Basic GEO Earth Ground Tester Kit
Fluke-1623-2	Basic GEO Earth Ground Tester
EI-1623	Selective/Stakeless Clamp Set for 1623
Fluke-1625-2 Kit	Advanced GEO Earth Ground Tester Kit
Fluke-1625-2	Advanced GEO Earth Ground Tester
EI-1625	Selective/Stakeless Clamp Set for 1625

## Optional accessories

ES-162P3-2	Stake Set for 3-Pole Measurement
ES-162P4-2	Stake Set for 4-Pole Measurement
EARTH STAKE	Ground/Earth Stake
CABLE REEL 25M BL	Ground/Earth Cable Reel 25 m (81.25 ft)
CABLE REEL 25M GR	Ground/Earth Cable Reel 25 m (81.25 ft)
CABLE REEL 50M RD	Ground/Earth Cable Reel 50 m (162.5 ft)
EI-162BN	320 mm (12.6 in) Split Core Transformer
EI-162X	Clip-on Current Transformer (Sensing) with Shielded Cable Set
EI-162AC	Clip-on Current Transformer (Inducing)



**Fluke.** *Keeping your world up and running.®*

**Fluke Corporation**  
PO Box 9090, Everett, WA 98206 U.S.A.

**Fluke Europe B.V.**  
PO Box 1186, 5602 BD  
Eindhoven, The Netherlands

**For more information call:**  
In the U.S.A. (800) 443-5853 or  
Fax (425) 446-5116  
In Europe/M-East/Africa +31 (0)40 267 5100 or  
Fax +31 (0)40 267 5222  
In Canada (800)-36-FLUKE or  
Fax (905) 890-6866  
From other countries +1 (425) 446-5500 or  
Fax +1 (425) 446-5116  
Web access: <http://www.fluke.com>

©2013, 2017 Fluke Corporation.  
Specifications subject to change without notice.  
Printed in U.S.A. 3/2017 2634980d-en

**Modification of this document is not permitted without written permission from Fluke Corporation.**